



INSTALLATION INSTRUCTIONS

LR100PDK

ELECTRIC LATCH RETRACTION DEVICE KIT


PHI/STANLEY MODELS: 2101, 2201, 2400, 2600, 2801, 5100 & 5200

Retrofit Installation Note: 42" or 48" exit devices that have been modified to fit a 36" or smaller opening, may not have the required space to fit the standard E. L. R. assembly. Always verify the distance from the end of the touchpad to the end rail, and if necessary, consult with the factory for appropriate selection.

Carefully remove the End Cap, End Cover, Device Housing and Pushbar. If present in device, remove dogging. Attach E. L. R. Assembly to Exit Device.

ELECTRICAL DATA
24VDC +/- 10%
1.5A Inrush / 200mA holding
RED (+) BLK (-)
PATENT #8,851,530

* Visit: sdsec.com/phi
For Installation Video

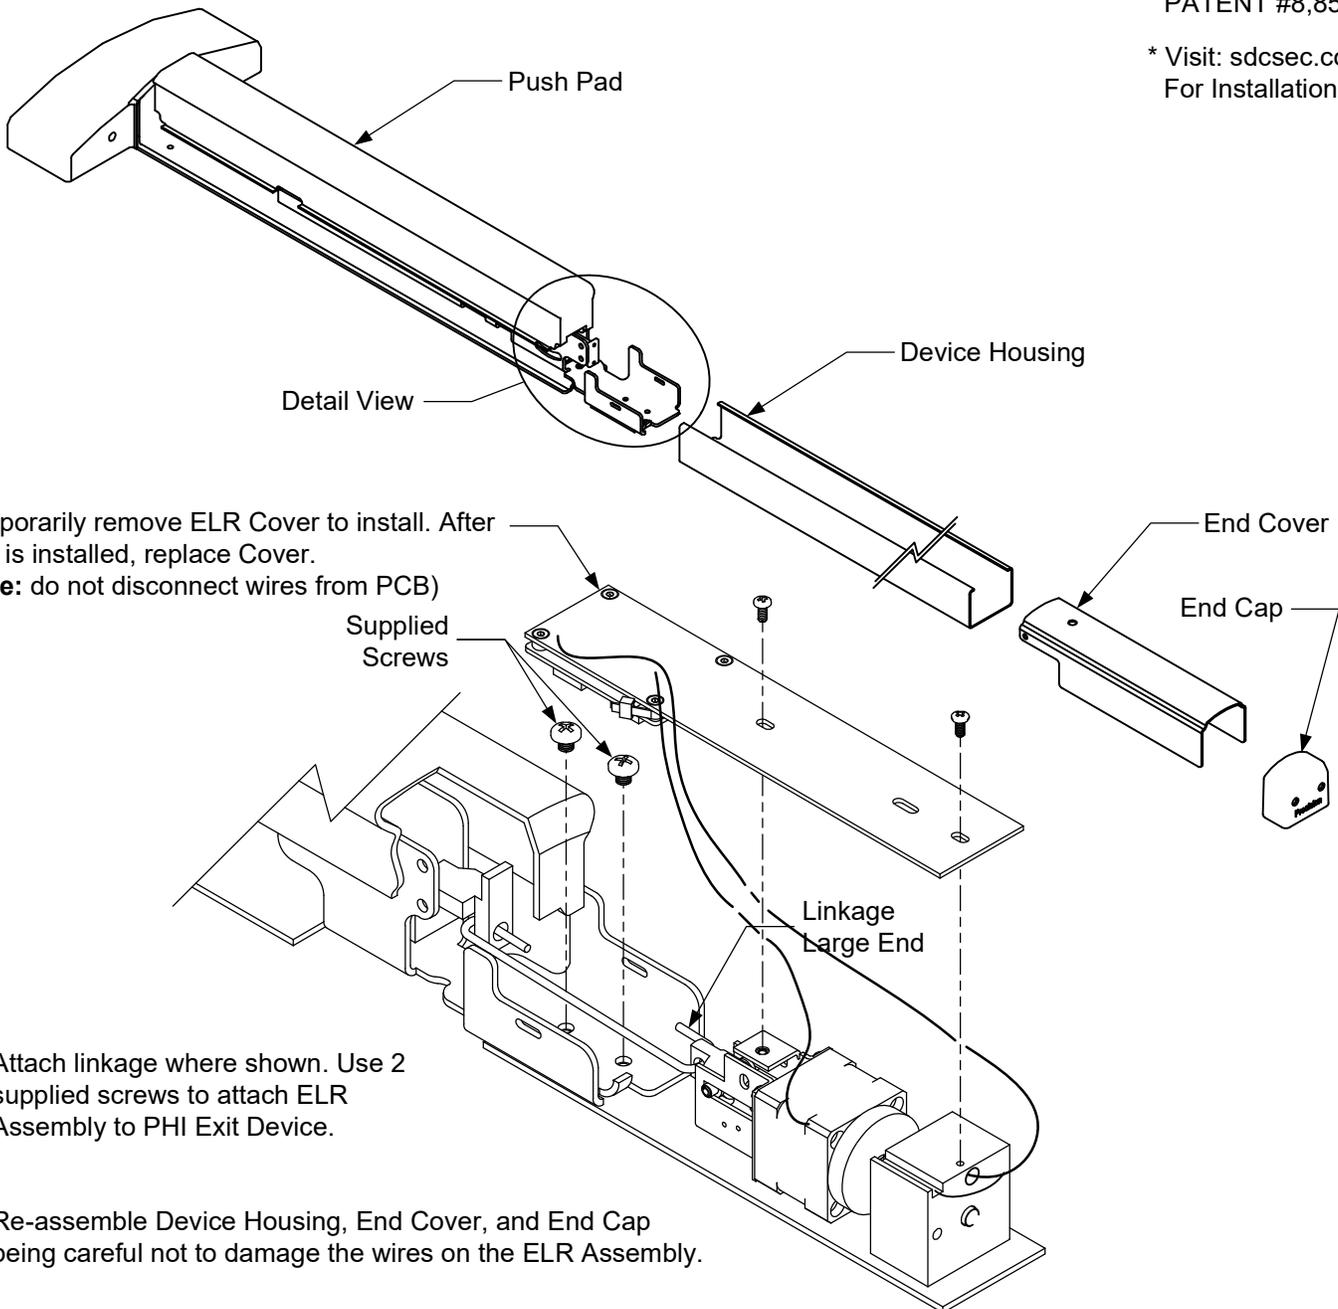

Temporarily remove ELR Cover to install. After ELR is installed, replace Cover.

(Note: do not disconnect wires from PCB)

Attach linkage where shown. Use 2 supplied screws to attach ELR Assembly to PHI Exit Device.

Re-assemble Device Housing, End Cover, and End Cap being careful not to damage the wires on the ELR Assembly.